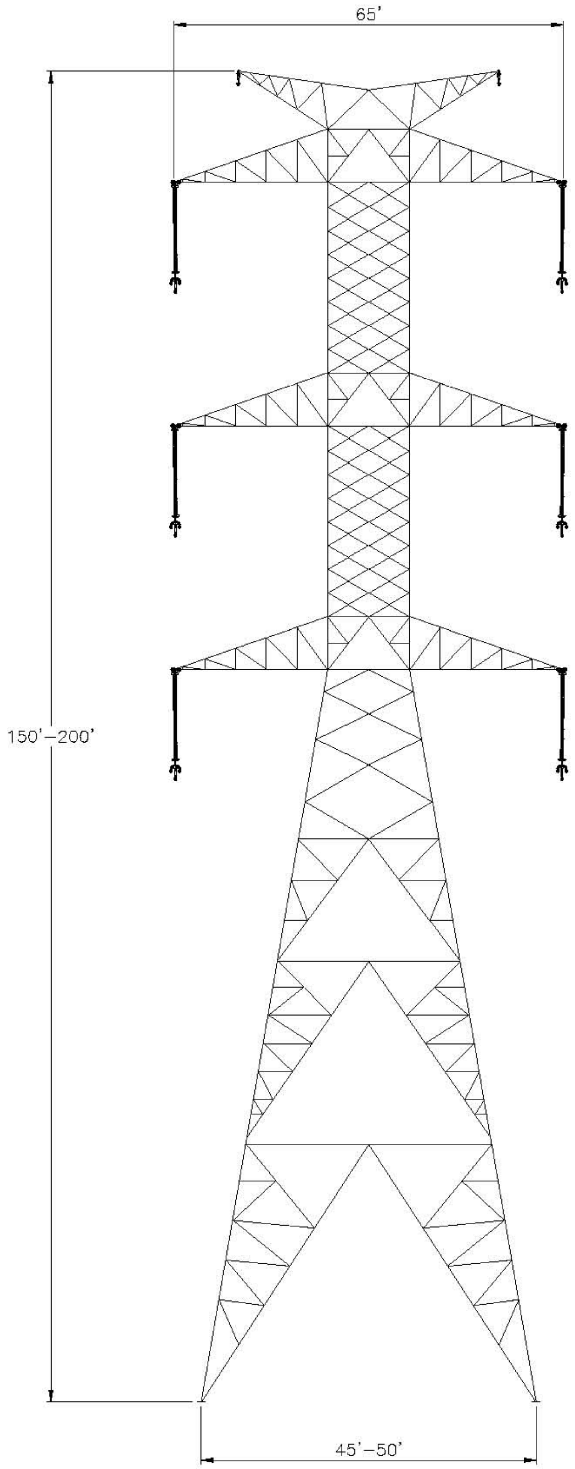

APPROVAL		
	BY	DATE
DRAWN	RLG	04/20/06
DESIGNED	SRP	04/20/06
CHECKED		
APPROVED		

Nevada Power.
TRANSMISSION ENGINEERING STANDARDS

SUNRISE TAP TRANSMISSION LINE PROJECT

FIGURE 2.4-1

Typical Double Circuit 500kV Lattice Structure

SHEET:

0

PLOT DATE/TIME: 4/21/2006 12:16 PM PLOTTED BY: GARDNER, RUSS

U:\NPC\TD\VOL1\TRANSCOM\PROJECTS\CENTENNIAL\HAMD\CTO\6 FRAMING DETAILS\LATTICE EXAMPLES\TYPNPC-DC500KV LATTICE TOWER.DWG

Thursday, August 7, 2008 9:37:30 AM
W:\NevadaPower\Apps\SRT\EA_FIG_REVISIONS_080508\Fig2-4-1_500KV_Lattice_080708.mxd