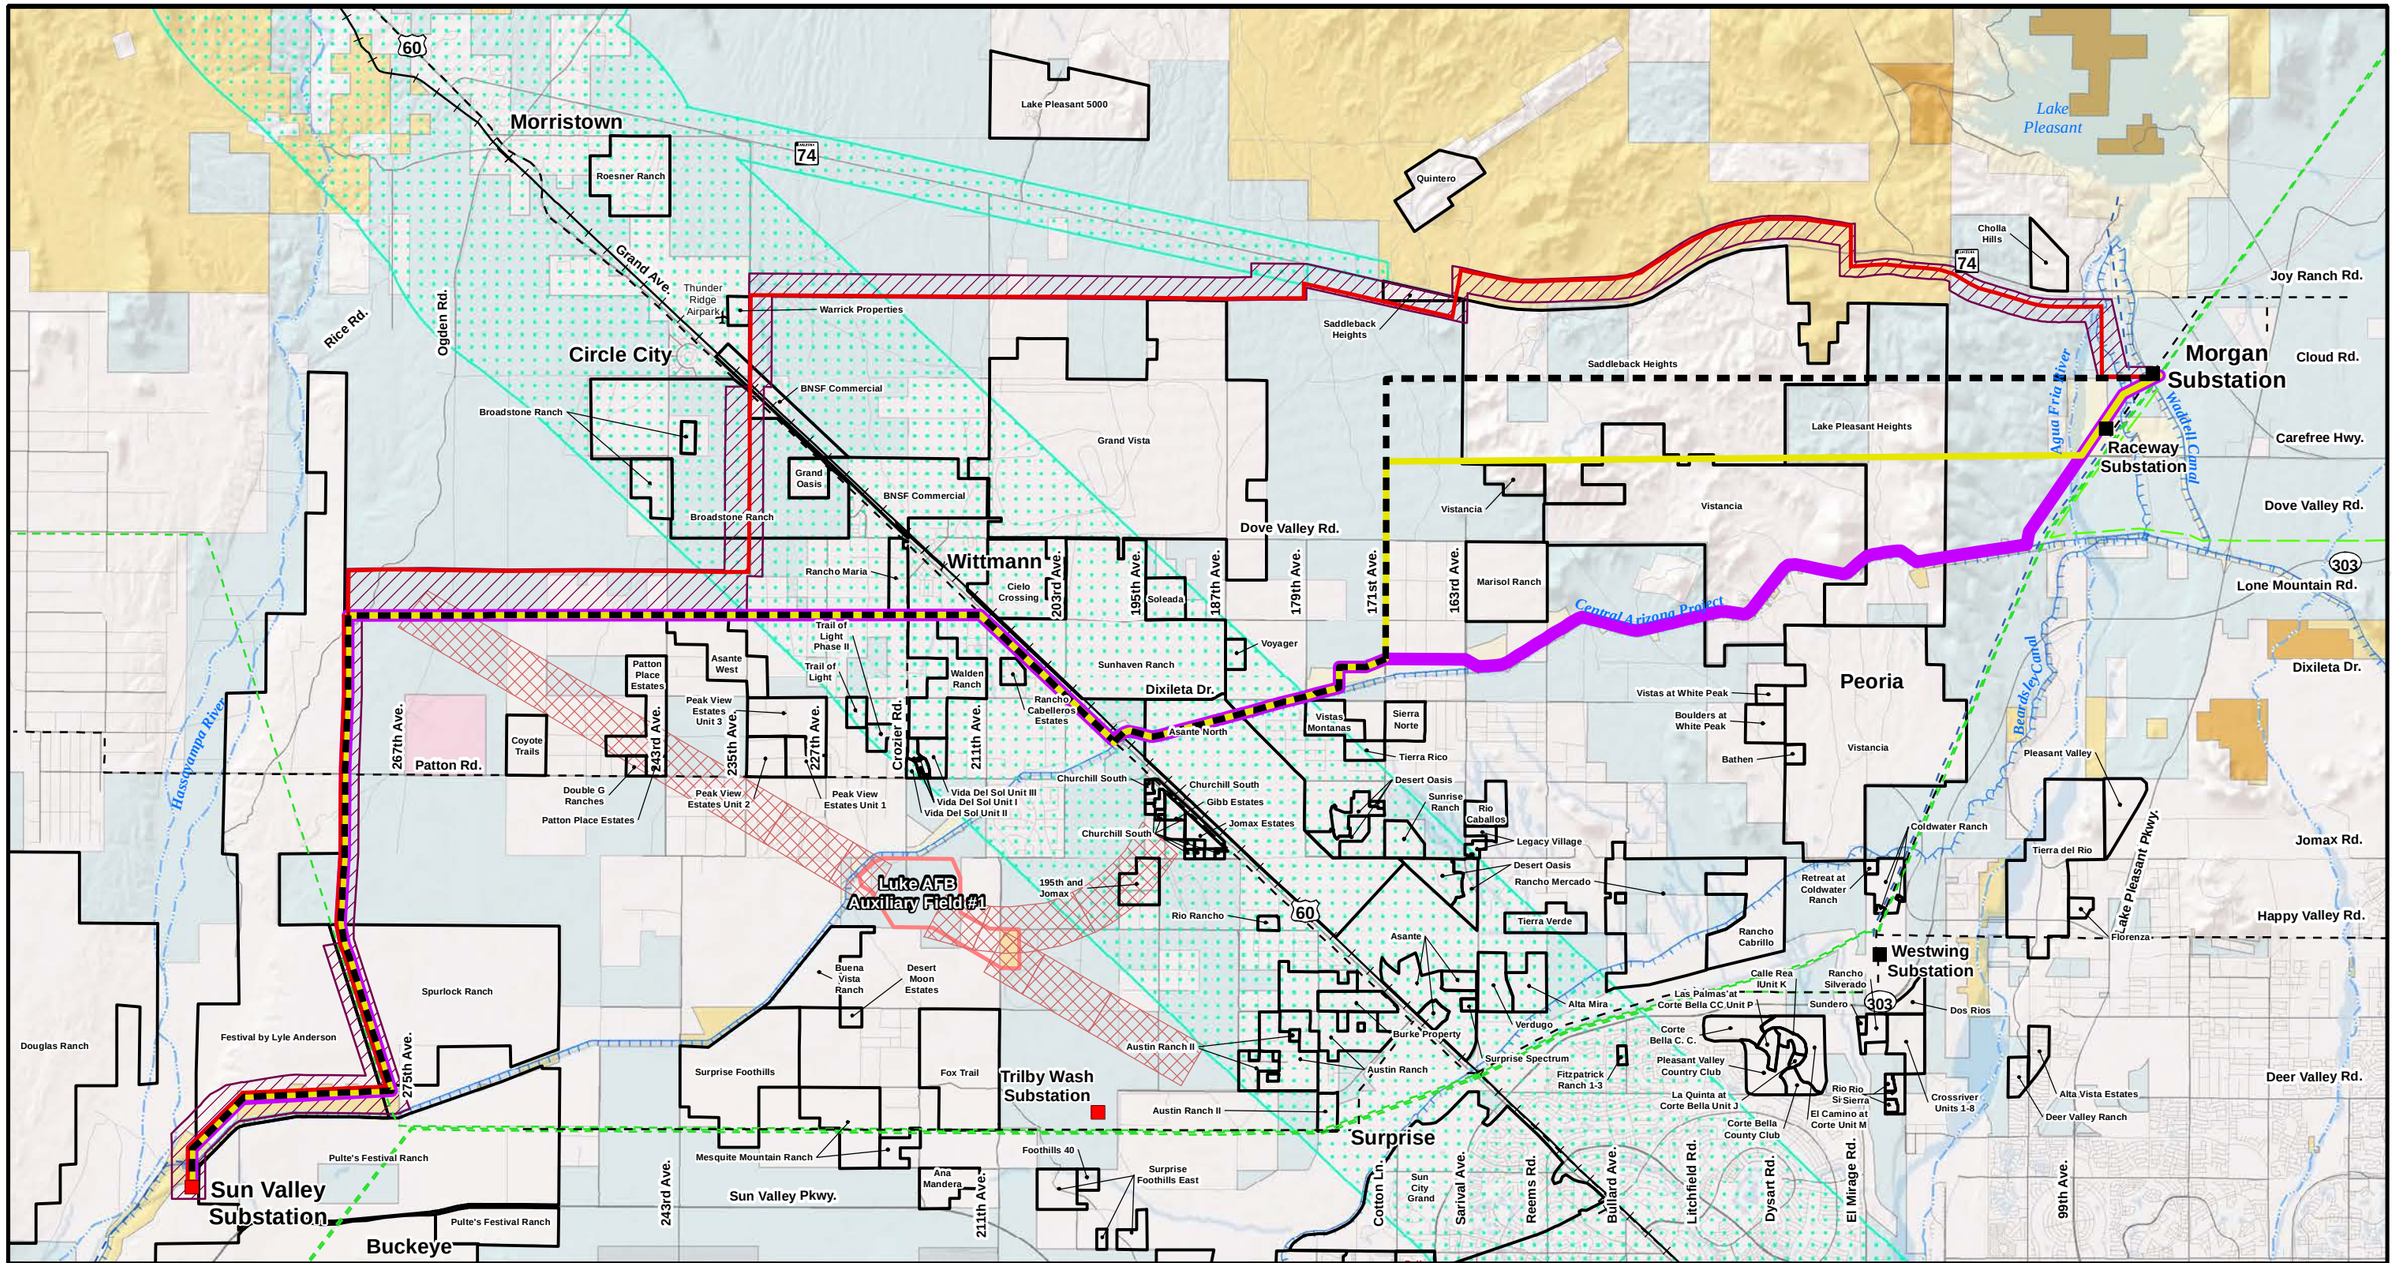


Figure 2.7-3
LAFB Auxiliary Field #1 Bypass Route, Options A, B, and C
Considered but Eliminated from Detailed Analysis
Sun Valley to Morgan 500/230kV Transmission Line EIS Project