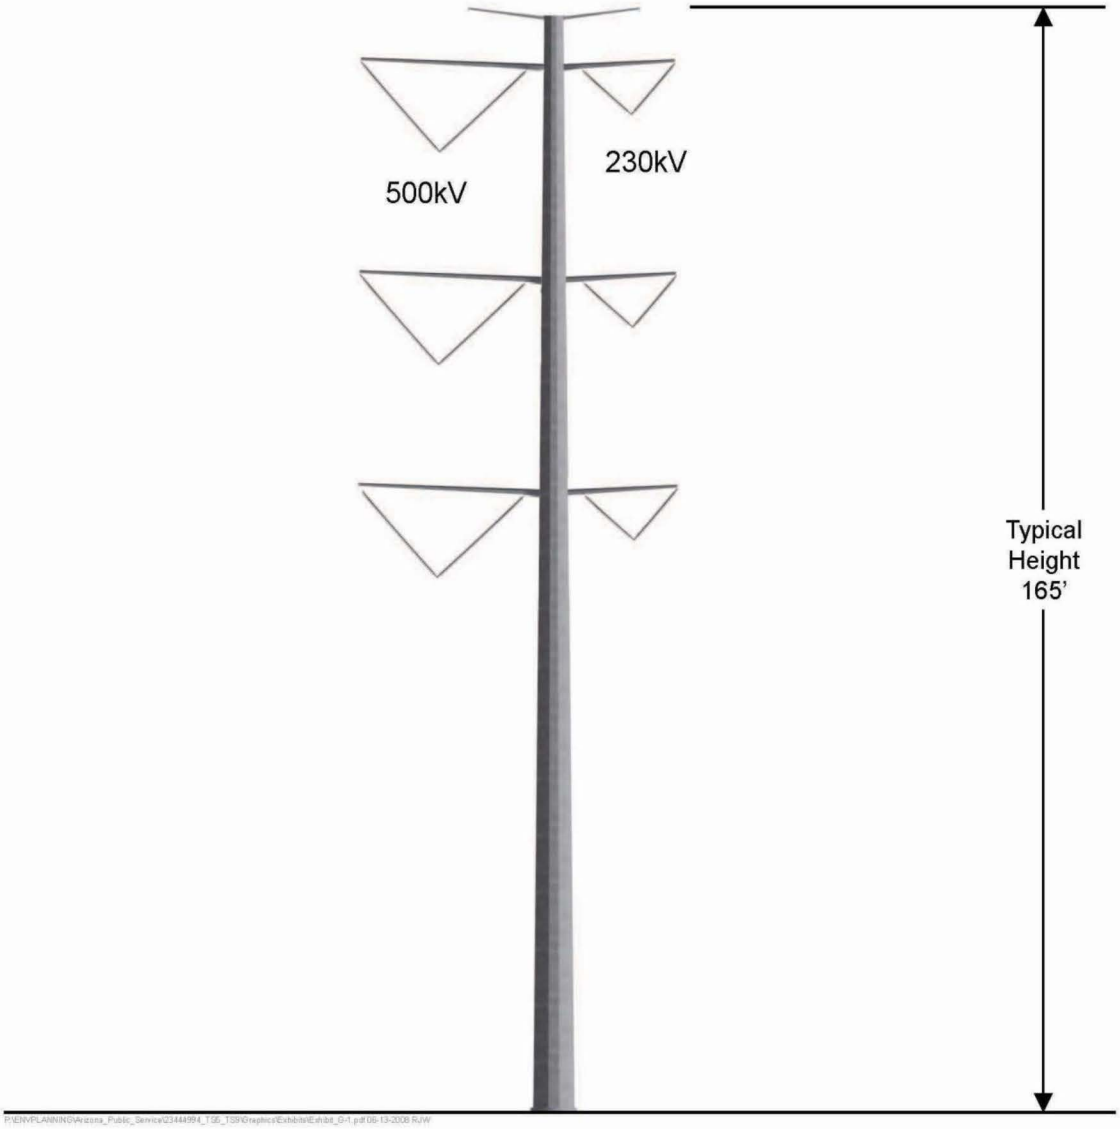

Figure 2.4-2 Typical 500/230kV Tangent Pole