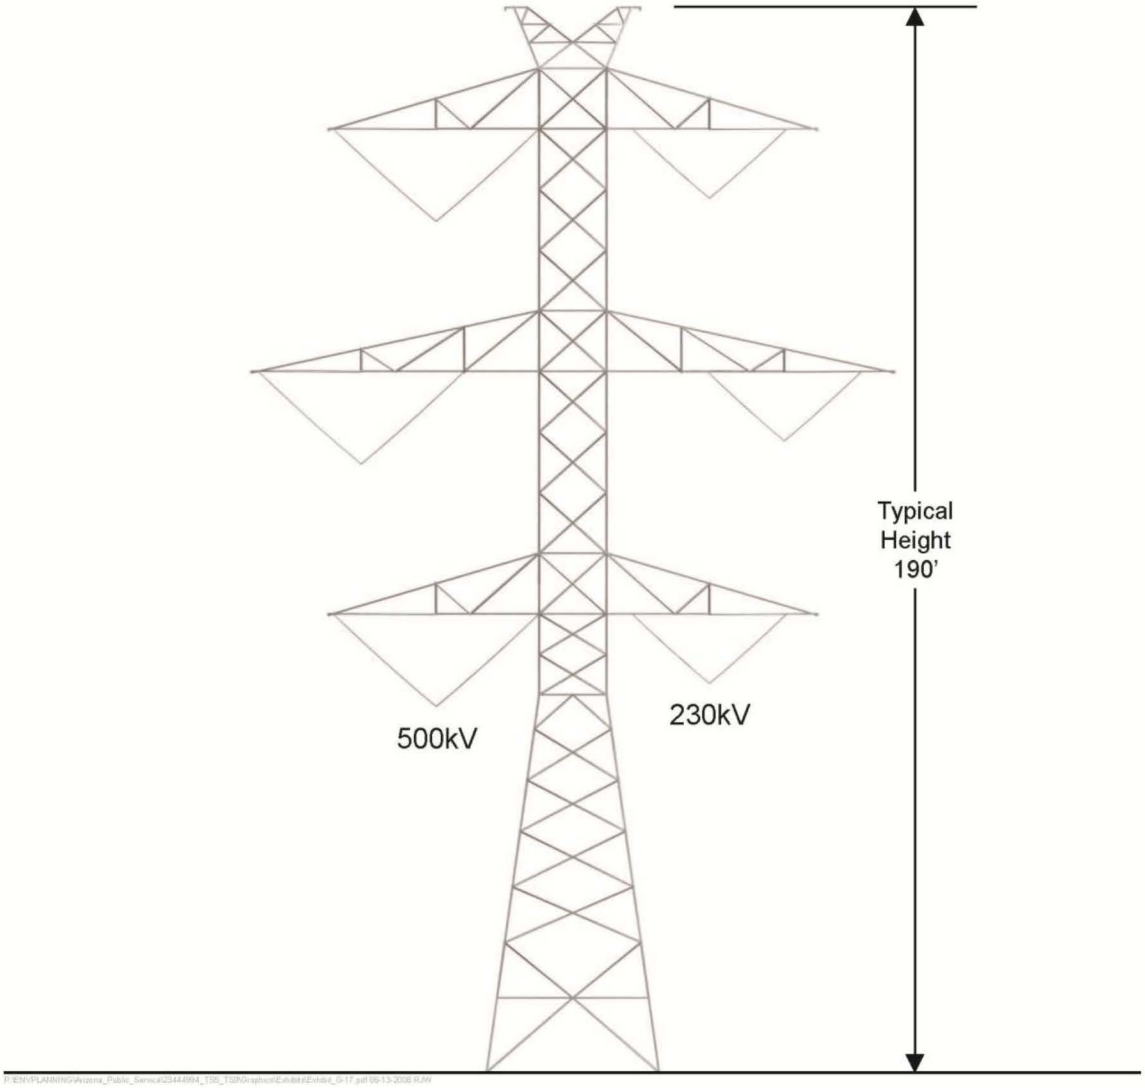

Figure 2.4-5 Double Circuit 500/230kV Tangent Lattice Tower