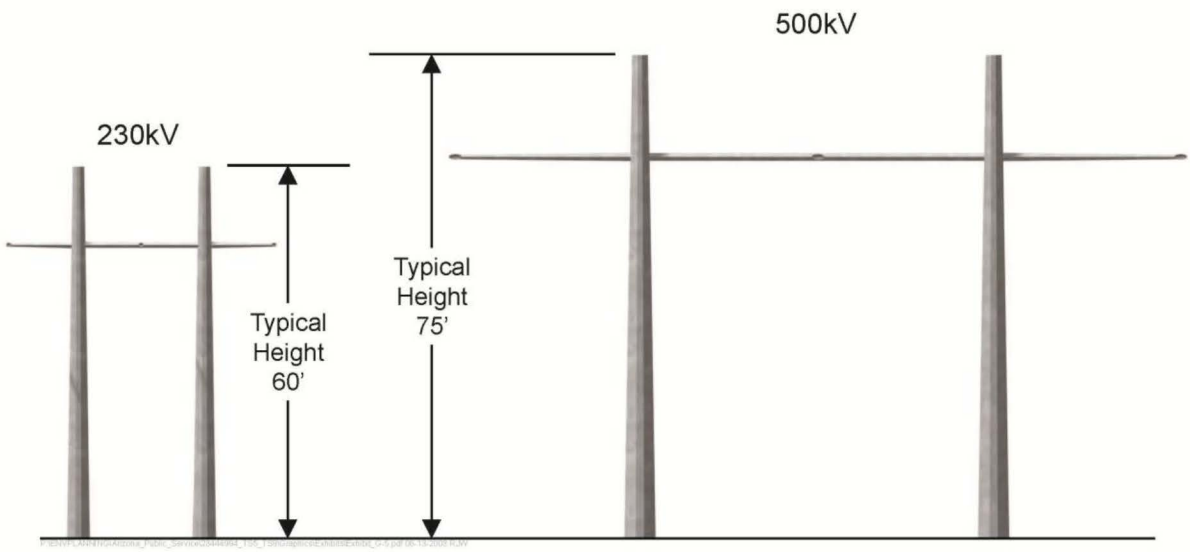

Figure 2.4-4 Typical 500/230kV H-Frame Structures