LAND			
LINE LIST	2283	2282	2281
LAND PLAT NUMBER			
PIPELINE STATION	10375+37	10350+00	10295+82 / 10295+00	10245+37
HORIZONTAL DISTANCE	2537 FT	5318 FT	5145 FT

PIPELINE STATIONING

10375+37 MATCHLINE
10353+29 P.I. < 006°46" RT.
10350+00 SECTION LINE
10348+80 MILEPOST 196R
10331+30 TEST LEAD TYPE 1
10295+82 SECTION LINE
10295+00 MILEPOST 195R & END 195R/BGR 115'R TEMP WORK SPACE
10278+48 TEST LEAD TYPE 3
10253+80 P.I. < 19°56'50" RT.
10251+54 P.I. < 19°55'55" RT.
10245+37 MATCHLINE

ALIGNMENT STRIP MAP

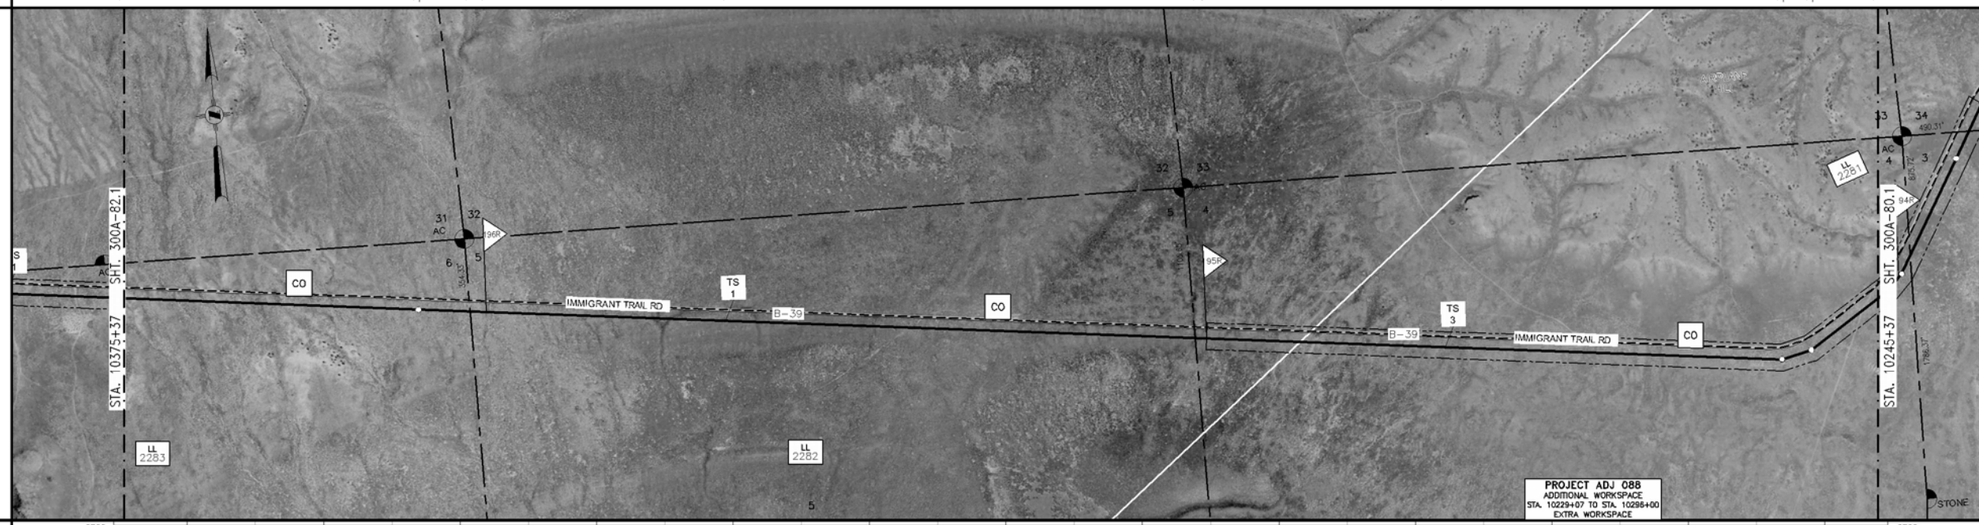

PROFILE — ELEVATION

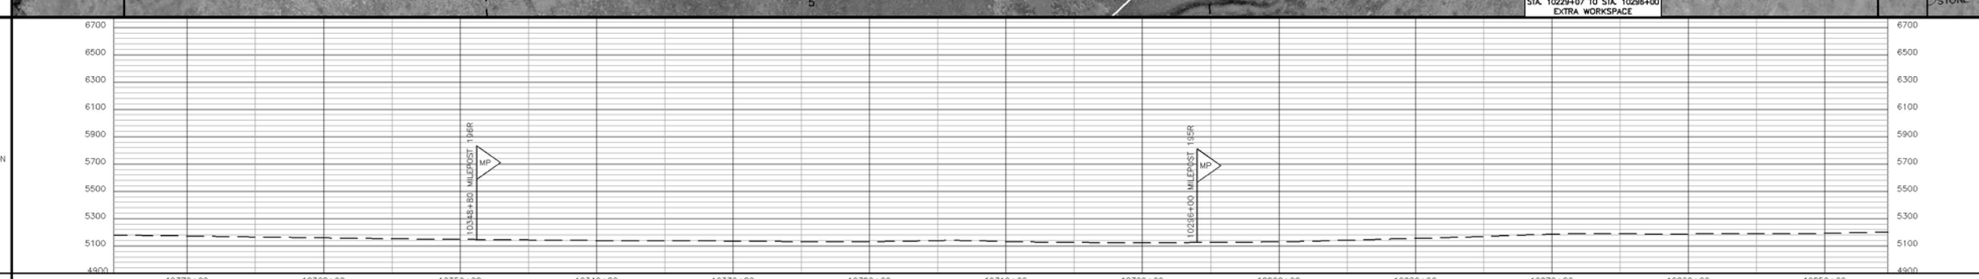

MATERIAL

PIPE CODE (SEE TABLE)	13000' (P1)	
PIPELINE	10375+37	10245+37
PIPESAKS		
COATING CODE (SEE TABLE)	13000' (C1)	
DESIGN FACTOR	.80	
CLASS LOCATION	CLASS 1	
DESIGN PRESSURE	1440	

GENERAL NOTES

1. THIS PIPELINE WILL BE INSTALLED UNDER TITLE 49 PART 192 CFR.
2. EL PASO COATING SPECIFICATION:
   A. PRODUCTION GIRTH WELDS – UC 235
   B. TIE-INS AND SHORT SECTIONS OF PIPE – UC 271
   C. ARO FIELD JOINTS – USE POWERCRETE-J PER SPEC UC 271
   D. ABOVE GROUND PIPING, VESSELS AND STRUCTURES – AC 135
3. ALL CONSTRUCTION R/W IS 115' WIDE EXCEPT AS NOTED.
4. EXTRA WORKSPACE IS APPLIED 40' TO EACH SIDE OF THE CONSTRUCTION WORKSPACE (195' WIDE TOTAL WORKSPACE) EXCEPT AS NOTED.
5. THE ENVIRONMENTAL INSPECTOR CAN APPROVE SHIFTING OF THE WORKSPACE WITHIN THE STUDY CORRIDOR AS APPROPRIATE.
6. THE CONSTRUCTION R/W IS LIMITED TO 75' WIDE IN WETLANDS EXCEPT AS NOTED.

LEGEND

- INTERSTATE HIGHWAY
- UNITED STATES HIGHWAY
- STATE HIGHWAY
- COUNTY HIGHWAY OR ROAD
- RAILROAD TRACKS
- ACCESS ROAD
- CREEK, RIVER, STREAM
- FOREIGN PIPELINE
- POWER LINE
- FIBER OPTICS LINE
- MAIN LINE VALVE (MLV)
- MAIN LINE VALVE DESIGNATION
- WELL
- ARCHAEOLOGICAL SITE
- ARCHAEOLOGICAL POINT
- WETLANDS AREA
- WETLANDS POINT
- STAGING AREAS

FOR LINE TYPES NOT SHOWN IN LEGEND, SEE EP STANDARD TYP-G-P-1.

SCALE & PROJECTION

500 250 0 500 1000

SCALE: 1" = 500' HORIZONTAL
1" = 500' VERTICAL

PROJECTION: UTM, NAD83, ZONE 12, US FOOT

NO.	DATE	BY	DESCRIPTION	PROJ. ID	APPR.
C	3/18/10	JDK	IMPLEMENTATION FILING	128575	JJJ
B	7/10/09	JDK	ISSUE FOR FERC FILING	128575	JJJ
A	1/26/09	JDK	ISSUE FOR FERC FILING	128575	JJJ

REVISIONS

RUBY PIPELINE LLC

ALIGNMENT SHEET
RUBY PIPELINE
300A-42 INCH

STA. 10245+37 TO STA. 10375+37

Division: ROCKY MOUNTAIN		Op. Area: ELKO	
State: UTAH		Co./Par.: BOX ELDER	
Section: –	Township: 10N	Range: 14W	
Drafter: JDK	Date: 08/27/08	Project ID: 128575	Type: CIVIL 3D
Chk'd: RJG	Date: 10/15/08	Scale: 1" = 500'	
Appr: JJJ	Date: 12/03/08	Filename: 0300-A-0081	

300A-81.1

Sheet: 81 of 277 Rev: 0

IMPLEMENTATION PLAN 05/24/2010

LL NO.	OWNERSHIP	LL NO.	OWNERSHIP
2281	USA-BLM		
2282	USA-BLM		
2283	USA-BLM		

MATERIAL SUMMARY

ITEM	DESCRIPTION	QTY
P1	PIPE,42.00 OD X 0.541 IN WT, DSAW,API 5L GR X-70	13000
C1	PIPE COATING TYPE 1	13000

TBD – TO BE DETERMINED

FIELD NOTES

TEST: SEE TEST FORM

RADIOGRAPH: PER EP CONSTRUCTION STANDARDS

COATING DEFINITIONS

TYPE 1 – PLANT APPLIED COATING
EXTERIOR: 14-16 MIL FUSION BONDED EPOXY (FBE).
INTERIOR: EFFICIENCY COATED PER IC-100.

TYPE 2 – PLANT APPLIED COATING: ABRASION RESISTANT SYSTEM 40 14-16 MIL MIN CORROSION & 40 MIL ARO

TYPE 3 – PLANT APPLIED COATING W/CONTRACTOR APPLIED CONCRETE: 14 MIL FUSION BONDED EPOXY (FBE) WITH 7" CONCRETE

TYPE 4 – FITTING/BEND COATING: SPECIFICATION UC 271.

TYPE 5 – SHOP FABRICATION: PLANT OR FIELD APPLIED PER EP CONSTRUCTION STANDARDS

MATERIAL DEFINITIONS

PIPESAK – PIPESAK WEIGHTS: SET-ON, 12500#, SPACING 12.5' ON CENTER

SCREW ANCHOR – SCREW ANCHOR SYSTEM: ANCHORPIPE #AP320-42, SPACING 80' ON CENTER

REFERENCE DRAWINGS

TYP-G-P-1	TYPICAL MAPPING SYMBOLS
TYP-G-P-2	TYPICAL PIPELINE CROSSINGS
TYP-P-P-123	TYPICAL DETAILS CATHODIC PROTECTION
TYP-P-P-124	TYPICAL DETAILS CATHODIC PROTECTION

ENVIRONMENTAL NOTES

1. EPHEMERAL STREAM – IF WATER IS PRESENT AT THE TIME OF CONSTRUCTION, THE TEMPORARY CONSTRUCTION WORKSPACE WILL BE LIMITED TO 115' AND THE EXTRA WORKSPACE WILL BE SET-BACK 50' FROM WATER'S EDGE.

MAY 14, 2010 – 10:14AM