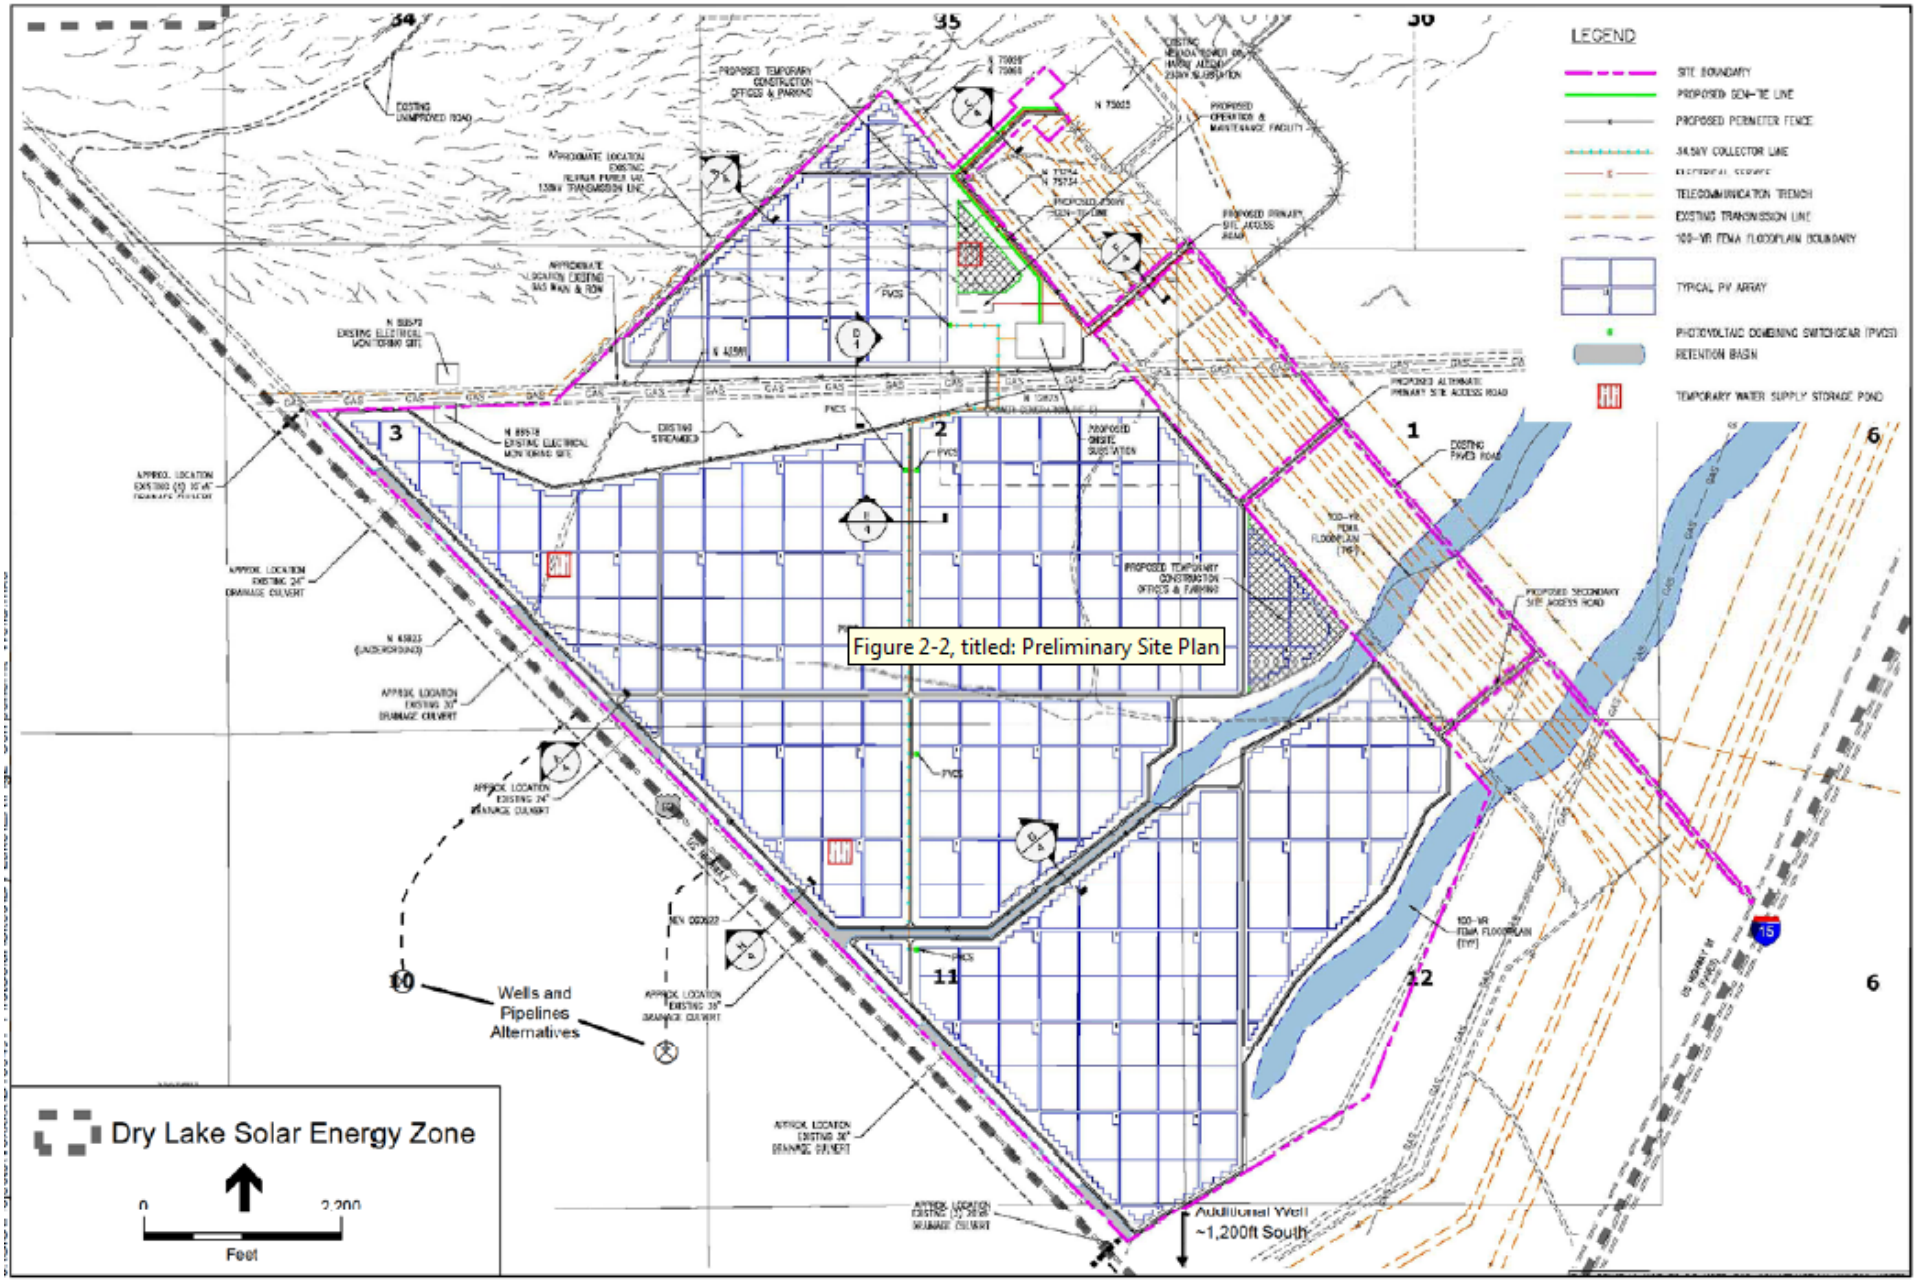
LEGEND
SITE BOUNDARY
PROPOSED SEN-TE LINE
PROPOSED PERIMETER FENCE
34.5kV COLLECTOR LINE
TELECOMMUNICATION TRENCH
EXISTING TRANSMISSION LINE
100-YR FEMA FLOODPLAIN BOUNDARY
TYPICAL PV ARRAY
PHOTOVOLTAIC COMBINING SWITCHGEAR (PVCS)
RETENTION BASIN
TEMPORARY WATER SUPPLY STORAGE POND
Figure 2-2, titled: Preliminary Site Plan
Wells and Pipelines Alternatives
Additional Well ~1,200ft South
Dry Lake Solar Energy Zone
0
2,200
Feet